


CITY PREFERRED CONFIGURATION
- NO SIDEWALK ON TOP OF WATER MAIN-

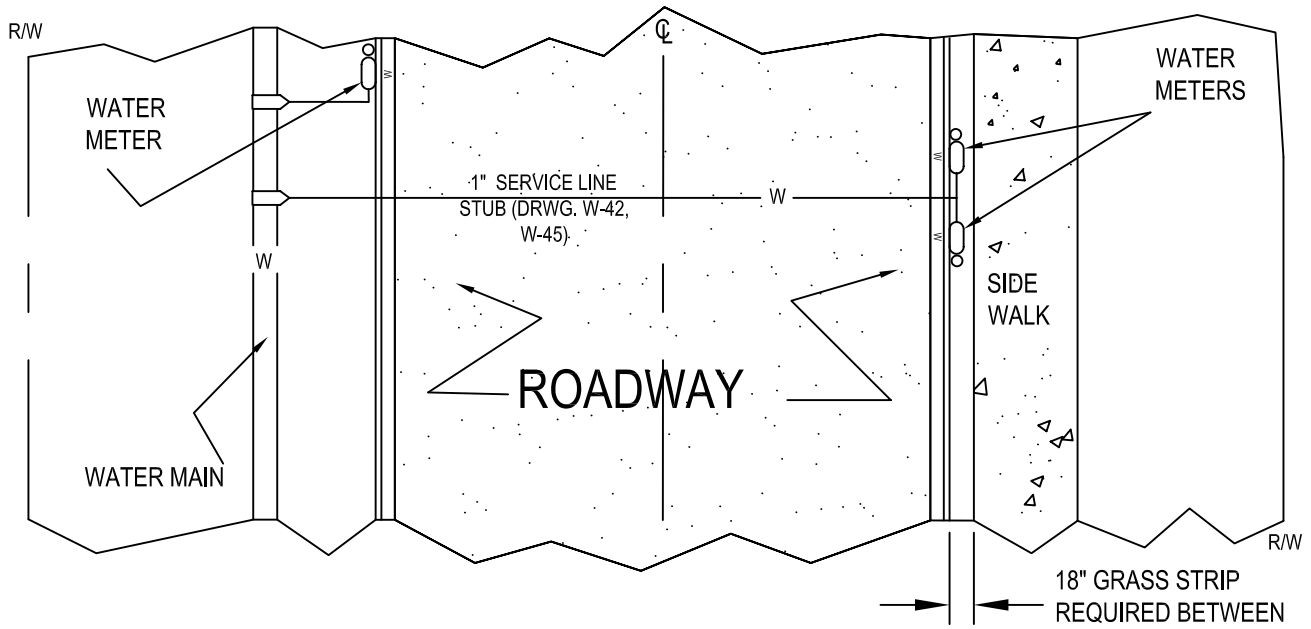


OPTIONAL CONFIGURATION
- SIDEWALK ON TOP OF WATER MAIN -
WATER MAIN MUST BE DIP
(NOT PREFERRED)

| REVISIONS |
| --- |
| |
| |
| |
| |
| |
| |
| |
| |

# City of Cumming

Department of Utilities - Distribution and Collection Division
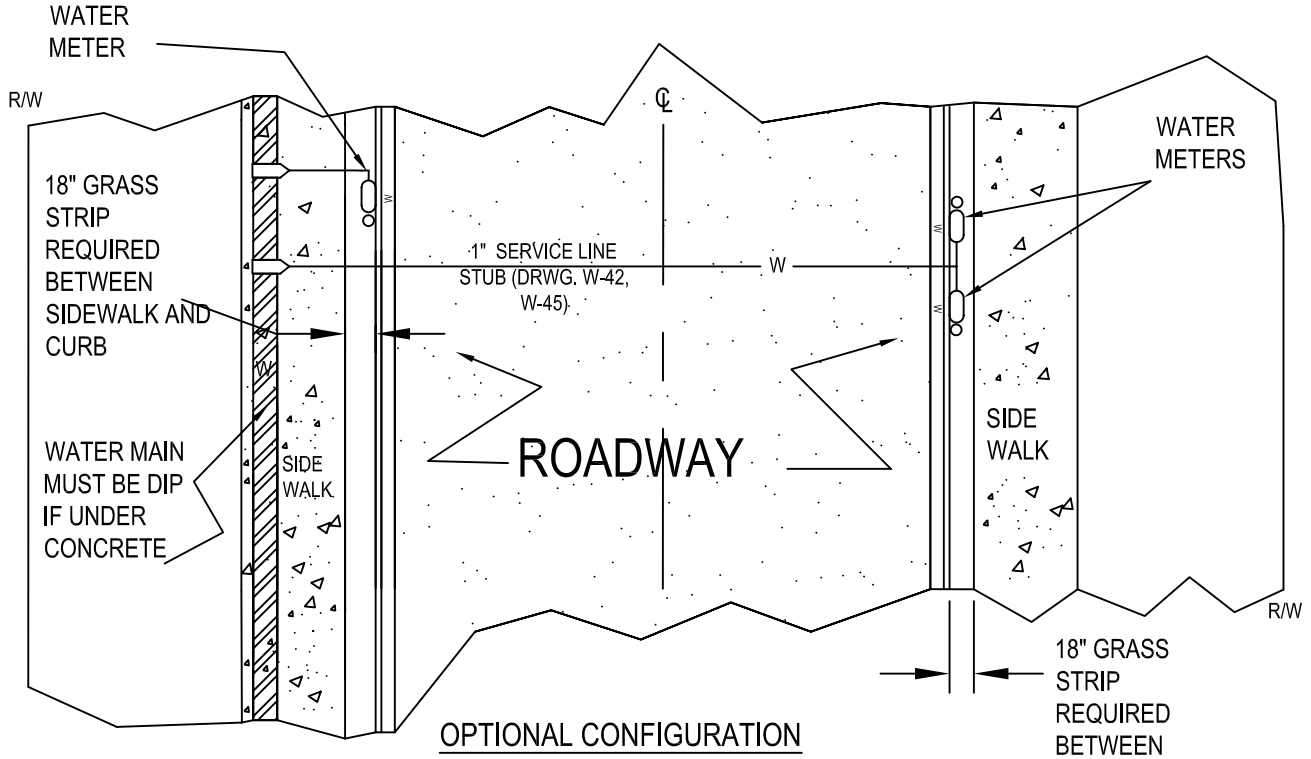
## WATER SYSTEM CONFIGURATION IN RELATION TO SIDEWALKS

W-41